

2019 APR 10 AM 10:09

2018 CERTIFICATION

Consumer Confidence Report (CCR)

NAVAL CONSTRUCTION BATTALION CENTER (NCBC) GULFPORT

Public Water System Name

MSQ240060

List PWS ID #s for all Community Water Systems included in this CCR

The Federal Safe Drinking Water Act (SDWA) requires each Community Public Water System (PWS) to develop and distribute a Consumer Confidence Report (CCR) to its customers each year. Depending on the population served by the PWS, this CCR must be mailed or delivered to the customers, published in a newspaper of local circulation, or provided to the customers upon request. Make sure you follow the proper procedures when distributing the CCR. **You must email, fax (but not preferred) or mail, a copy of the CCR and Certification to the MSDH.** Please check all boxes that apply.

- Customers were informed of availability of CCR by: *(Attach copy of publication, water bill or other)*
- Advertisement in local paper *(Attach copy of advertisement)*
 - On water bills *(Attach copy of bill)*
 - Email message *(Email the message to the address below)*
 - Other _____

Date(s) customers were informed: 04 / 08 / 2019 / / / 2019 / / / 2019

- CCR was distributed by U.S. Postal Service or other direct delivery. Must specify other direct delivery methods used _____

Date Mailed/Distributed: _____ / _____ / _____

- CCR was distributed by Email *(Email MSDH a copy)* Date Emailed: 04 / 09 / 2019
- As a URL _____ *(Provide Direct URL)*
 - As an attachment
 - As text within the body of the email message

- CCR was published in local newspaper. *(Attach copy of published CCR or proof of publication)*

Name of Newspaper: _____

Date Published: _____ / _____ / _____

- CCR was posted in public places. *(Attach list of locations)* Date Posted: _____ / _____ / 2019

- CCR was posted on a publicly accessible internet site at the following address: _____

(Provide Direct URL)

CERTIFICATION

I hereby certify that the CCR has been distributed to the customers of this public water system in the form and manner identified above and that I used distribution methods allowed by the SDWA. I further certify that the information included in this CCR is true and correct and is consistent with the water quality monitoring data provided to the PWS officials by the Mississippi State Department of Health, Bureau of Public Water Supply

CDR William R. Pitcairn

Name/Title (Board President, Mayor, Owner, Admin. Contact, etc.)

William R. Pitcairn 9 APR 2019

Date

Submission options (Select one method ONLY)

Mail: (U.S. Postal Service)
MSDH, Bureau of Public Water Supply
P.O. Box 1700
Jackson, MS 39215

Email: water.reports@msdh.ms.gov

Fax: (601) 576 - 7800

****Not a preferred method due to poor clarity****

CCR Deadline to MSDH & Customers by July 1, 2019!

2
0
1
8

**NCBC
Water
Quality
Consumer
Confidence
Report**



RECEIVED - WATER SUPPLY
2019 APR 11 AM 8:44

Public Water System (PWS) ID No. MS0240060

NCBC Gulfport - 2018 Water Quality Consumer Confidence Report (CCR)

Is my water safe?

We are pleased to present this year's Annual Water Quality Report (Consumer Confidence Report) as required by the Safe Drinking Water Act (SDWA). This report is designed to provide details about where your water comes from, what it contains, and how it compares to standards set by regulatory agencies. This report is a snapshot of last year's water quality. We are committed to providing you with information because informed customers are our best allies.

Do I need to take special precautions?

Some people may be more vulnerable to contaminants in drinking water than the general population. Immuno-compromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at risk from infections. These people should seek advice about drinking water from their health care providers. EPA/Centers for Disease Control (CDC) guidelines on appropriate means to lessen the risk of infection by Cryptosporidium and other microbial contaminants are available from the Safe Water Drinking Hotline (800-426-4791)

Where does my water come from?

Naval Construction Battalion Center (NCBC) Gulfport receives water from the Graham Ferry aquifer. The Graham Ferry aquifer is part of the Miocene aquifer system that consists of multiple layers of sand separated by beds of clay. A U.S. Geological Survey study of groundwater in Harrison County found that aquifers deeper than 500 feet were artesian. The groundwater from NCBC Gulfport water supply is pumped from three wells that are well in excess of 700 feet.

Why are there contaminants in my drinking water?

Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the Environmental Protection Agency's (EPA) Safe Drinking Water Hotline (800-426-4791). The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over the surface of the land or through the ground, it dissolves naturally occurring minerals and, in some cases, radioactive material, and can pick up substances resulting from the presence of animals or from human activity: microbial contaminants, such as viruses and bacteria, that may come from sewage treatment plants, septic systems, agricultural livestock operations, and wildlife; inorganic contaminants, such as salts and metals, which can be naturally occurring or result from urban stormwater runoff, industrial, or domestic wastewater discharges, oil and gas production, mining, or farming; pesticides and herbicides, which may come from a variety of sources such as agriculture, urban stormwater runoff, and residential uses; organic Chemical Contaminants, including synthetic and volatile organic chemicals, which are by-products of industrial processes and petroleum production, and can also come from gas stations, urban stormwater runoff, and septic systems; and radioactive contaminants, which can be naturally occurring or be the result of oil and gas production and mining activities. In order to ensure that tap water is safe to drink, EPA prescribes regulations that limit the amount of certain contaminants in water provided by public water systems. Food and Drug Administration (FDA) regulations establish limits for contaminants in bottled water which must provide the same protection for public health.

How can I get involved?

The best mechanism to get involved consists of participating in Housing Residence meetings. The most current information about the meetings may be obtained by contacting the Housing Office at (228) 871-2586 or Belfour Beatty Community at (228) 863-0424.

The Consumer Confidence Report (CCR) will not be mailed to customers, but is posted on the NCBC Gulfport Environmental Support webpage. A hard copy of the CCR can be obtained from the Center's Environmental Office located in Building 322, Room 103 or by emailing a request for a copy to kenton.lottinger@navy.mil. The PWD Environmental Division encourages all consumers that have concerns or questions to contact them directly at (228) 871-2373.

Description of Water Treatment Process

Your water is treated by disinfection. Disinfection involves the addition of chlorine or other disinfectant to kill dangerous bacteria and microorganisms that may be in the water. Disinfection is considered to be one of the major public health advances of the 20th century.

Water Conservation Tips

Did you know that the average U.S. household uses approximately 400 gallons of water per day or 100 gallons per person per day? Luckily, there are many low-cost and no-cost ways to conserve water. Small changes can make a big difference - try one today and soon it will become second nature.

- Take short showers - a 5-minute shower uses 4 to 5 gallons of water compared to up to 50 gallons for a bath.
- Shut off water while brushing your teeth, washing your hair and shaving and save up to 500 gallons a month.
- Use a water-efficient showerhead. They're inexpensive, easy to install, and can save you up to 750 gallons a month.
- Run your clothes washer and dishwasher only when they are full. You can save up to 1,000 gallons a month.
- Water plants only when necessary.
- Fix leaky toilets and faucets. Faucet washers are inexpensive and take only a few minutes to replace. To check your toilet for a leak, place a few drops of food coloring in the tank and wait. If it seeps into the toilet bowl without flushing, you have a leak. Fixing it or replacing it with a new, more efficient model can save up to 1,000 gallons a month.
- Adjust sprinklers so only your lawn is watered. Apply water only as fast as the soil can absorb it and during the cooler parts of the day to reduce evaporation.
- Teach your kids about water conservation to ensure a future generation that uses water wisely. Make it a family effort to reduce next month's water bill!
- Visit www.epa.gov/watersense for more information.

NCBC Gulfport - 2018 Water Quality Consumer Confidence Report (CCR)

NCBC Gulfport - 2018 Water Quality Consumer Confidence Report (CCR)

Cross Connection Control Survey

The purpose of this survey is to determine whether a cross-connection may exist at your home or business. A cross connection is an unprotected or improper connection to a public water distribution system that may cause contamination or pollution to enter the system. We are responsible for enforcing cross-connection control regulations and insuring that no contaminants can, under any flow conditions, enter the distribution system.

If you have any of the devices listed below please contact us so that we can discuss the issue, and if needed, survey your connection and assist you in isolating it if that is necessary.

- Boiler/ Radiant heater (water heaters not included)
- Underground lawn sprinkler system
- Pool or hot tub (whirlpool tubs not included)
- Additional source(s) of water on the property
- Decorative pond
- Watering trough

Source Water Protection Tips

Protection of drinking water is everyone's responsibility. You can help protect your community's drinking water source in several ways:


- Eliminate excess use of lawn and garden fertilizers and pesticides - they contain hazardous chemicals that can reach your drinking water source.
- Pick up after your pets.
- Dispose of chemicals properly; take used motor oil to a recycling center.
- Volunteer in your community. Find a watershed or wellhead protection organization in your community and volunteer to help. If there are no active groups, consider starting one. Use EPA's Adopt Your Watershed to locate groups in your community, or visit the Watershed Information Network's How to Start a Watershed Team.

Additional Information for Lead

If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. Naval Construction Battalion Center (NCBC) Gulfport is responsible for providing high quality drinking water, but cannot control the variety of materials used in plumbing components. When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using water for drinking or cooking. If you are concerned about lead in your water, you may wish to have your water tested. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline or at <http://www.epa.gov/safewater/lead>. NCBC Gulfport periodically tests for lead in your water in accordance with EPA and Mississippi State Department of Health (MSDH) regulatory requirements. Your water's lead level is well below the Action Level (AL) as indicated in the Water Quality Data Table. Additional Information for Fluoride.

To comply with a Department of Defense initiative to increase military personnel dental readiness, in late 2014 fluoride was added in accordance with EPA and MSDH standards. Although, there is some naturally occurring fluoride in the water, to achieve dental readiness the level must be maintained within the range of 0.6-1.2 ppm with 0.7 ppm being the optimal level.

To comply with the "Regulation Governing Fluoridation of Community Water Supplies", MS0240060 is required to report certain results pertaining to fluoridation of our water system. The number of months in the previous calendar year in which average fluoride sample results were within the optimal range of 0.6-1.2 ppm was 12. The percentage of fluoride samples collected in the previous calendar year that was within the optimal range of 0.6-1.2 ppm was 94%.

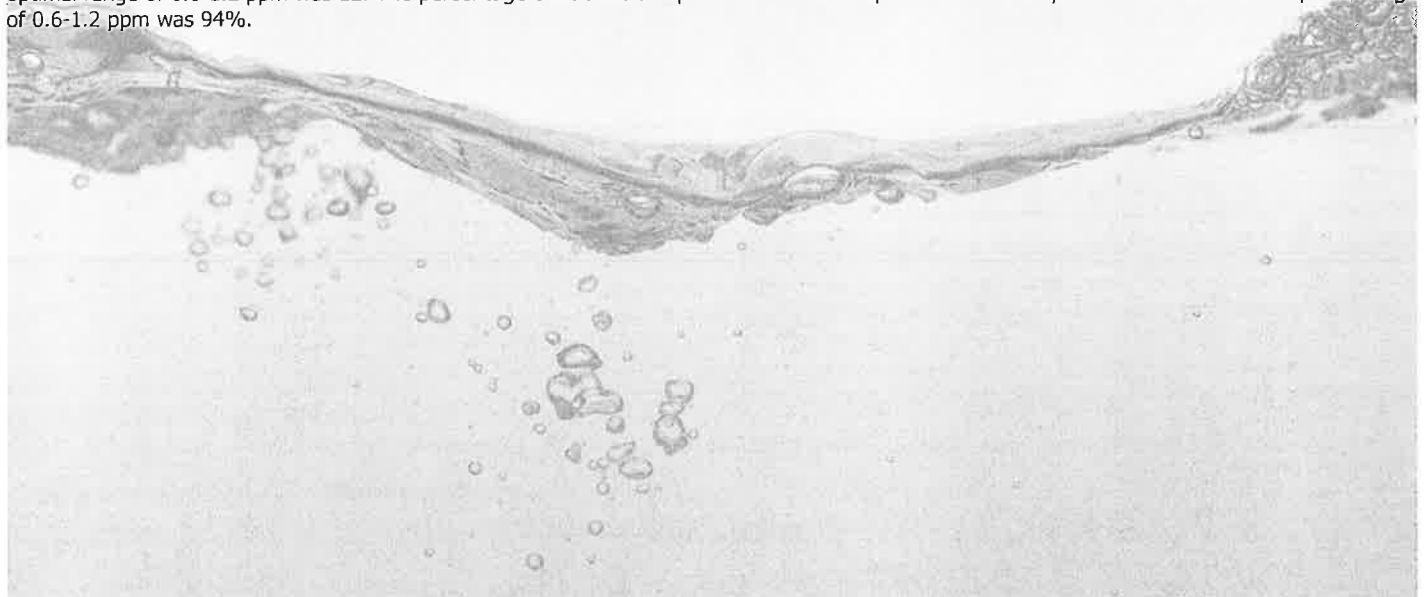

| Contaminants | MCLG or MRDLG | MCL, TT, or MRDL | Detect In Your Water | Range | | Sample Date | Violation | Typical Source |
|---|---------------------|------------------------|-------------------------------|-------------|------------------------|----------------|--|---|
| | | | | Low | High | | | |
| Disinfectants & Disinfection By-Products | | | | | | | | |
| (There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants) | | | | | | | | |
| Chlorine (as Cl ₂) (ppm) | 4 | 4 | 0.90 | 0.08 | 1.52 | 2018 | No | Water additive used to control microbes |
| Haloacetic Acids (HAA5) (ppb) | NA | 60 | 2 | NA | NA | 2018 | No | By-product of drinking water chlorination |
| TTHMs [Total Trihalomethanes] (ppb) | NA | 80 | 4.61 | NA | NA | 2018 | No | By-product of drinking water disinfection |
| Inorganic Contaminants | | | | | | | | |
| Barium (ppm) | 2 | 2 | 0.01 | 0.0076 | 0.01 | 2018 | No | Discharge of drilling wastes; Discharge from metal refineries; Erosion of natural deposits |
| Chromium (ppb) | 100 | 100 | 0.7 | 0.6 | 0.7 | 2018 | No | Discharge from steel and pulp mills, Erosion of natural deposits |
| Fluoride (ppm) | 4 | 4 | 1.18 | 0.847 | 1.18 | 2018 | No | Erosion of natural deposits; Water additive which promotes strong teeth; Discharge from fertilizer and aluminum factories |
| Contaminants | MCLG | AL | Your Water | Sample Date | # Samples Exceeding AL | Exceeds AL | Typical Source | |
| Inorganic Contaminants | | | | | | | | |
| Copper - action level at consumer taps (ppm) | 1.3 | 1.3 | 0.1 | 2018 | 0 | No | Corrosion of household plumbing systems; Erosion of natural deposits | |
| Inorganic Contaminants | | | | | | | | |
| Lead - action level at consumer taps (ppb) | 0 | 15 | 2 | 2018 | 0 | No | Corrosion of household plumbing systems; Erosion of natural deposits | |

| Unit Descriptions | |
|-------------------|--|
| Term | Definition |
| ug/L | ug/L : Number of micrograms of substance in one liter of water |
| ppm | ppm: parts per million, or milligrams per liter (mg/L) |
| ppb | ppb: parts per billion, or micrograms per liter (µg/L) |
| pCi/L | pCi/L: picocuries per liter (a measure of radioactivity) |
| NA | NA: not applicable |
| ND | ND: Not detected |
| NR | NR: Monitoring not required, but recommended. |

| Important Drinking Water Definitions | |
|--------------------------------------|---|
| Term | Definition |
| MCLG | MCLG: Maximum Contaminant Level Goal: The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety. |
| MCL | MCL: Maximum Contaminant Level: The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to the MCLGs as feasible using the best available treatment technology. |
| TT | TT: Treatment Technique: A required process intended to reduce the level of a contaminant in drinking water. |
| AL | AL: Action Level: The concentration of a contaminant which, if exceeded, triggers treatment or other requirements which a water system must follow. |
| Variances and Exemptions | Variances and Exemptions: State or EPA permission not to meet an MCL or a treatment technique under certain conditions. |
| MRDLG | MRDLG: Maximum residual disinfection level goal. The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants. |
| MRDL | MRDL: Maximum residual disinfectant level. The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants. |
| MNR | MNR: Monitored Not Regulated |
| MPL | MPL: State Assigned Maximum Permissible Level |

For more information please contact:

Contact Name: Kenton Lottinger
 Address: 2401 Upper Nixon Ave., Bldg 322
 Gulfport, MS 39501
 Phone: 228-871-2373



+ New message Delete Archive Junk Sweep Move to Categorize The new Outlook

- Favorites
- Folders
 - Inbox 2
 - Junk E-Mail 1
 - Drafts
 - Sent Items
 - Deleted Items
 - Archive
 - CCR's
 - Conversation Hist...
 - New folder
- In-Place Archive -r...
- Groups
 - New group
 - Discover groups

- Focused Other Filter
- CG Cecilia Garris CCR5 11:09 AM
 CCRs Attached
 braxton.pdf +7
- Yesterday
- Lottinger, Kenton L CIV USN NAVFAC SE... NCBC Gulfport - PWD ID#... Tue 8:45 PM
 Lottinger, Kenton CIV NAVFAC SE, PWD G...
 - Lottinger, Kenton L CIV USN NAVFAC SE J. ALL HANDS - NCBC Gulfpo... Tue 5:13 PM
 To: MSDH, Bureau of Public Water Supply...
 - Lottinger, Kenton L CIV USN NAVFAC SE J. NCBC Gulfport's 2018 Wat... Tue 3:54 PM
 To: All addressees Attached is a copy of N...

NCBC Gulfport's 2018 Water Quality Consumer Conf...

- S/MIME isn't supported in this view. To view this message in a new window, click here
- The message sender has requested a read receipt. To send a receipt, click here.

Lottinger, Kenton L CIV USN NAVFAC SE JAX FL (US) <kenton.lottinger@navy.mil>
 Tue 4/9/2019 3:54 PM
 Boogaart, Derek... +42 others

NCBCGPT 2018 Water Quality...
 2 MB

To: All addressees

Attached is a copy of NCBC Gulfport 2018 Water Quality - Consumer Confidence Report (CCR).

Please insure the report is disseminated to all water users and consumers within your respective department or command by posting on command bulletin boards and/or by forwarding this email along with attachment on to them.

This report is required by USEPA and MSDH regulations to be disseminate to all water users and consumers on NCBC Gulfport as soon as possible but not later than 1 July 2019.

In addition, water users and consumers can obtain an electronic and/or hard copy of the report from the Public Works Department, Environmental Division office located in Building 322, Room 103 or by emailing a request to the PWD Environmental Div., Water Program Manager, at kenton.lottinger@navy.mil or by calling him at 228-871-2373.

Should you have any questions in regards to the report, please contact me.

Respectfully,
 Kenton Lottinger
 NCBC Gulfport
 NAVFACSE PWD Gulfport
 Environmental Division
 Air, Water & EMS Program Manager
 COMM: (228) 871-2373
 DSN: 868-2373
 Email: kenton.lottinger@navy.mil

FOR OFFICIAL USE ONLY - Privacy Act of 1974, as amended, applies. This email may contain information that must be protected in accordance with 5 U.S.C.s 552a as implemented within the DoD by 32 CFR



Lottinger, Kenton L CIV USN NAVFAC SE JAX FL (US)

From: Lottinger, Kenton L CIV USN NAVFAC SE JAX FL (US)
Sent: Tuesday, April 9, 2019 12:10 PM
To: water.reports@msdh.ms.gov
Cc: Noble, Lisa L CIV USN (US)
Subject: FW: ALL HANDS - NCBC Gulfport - 2018 Water Quality Consumer Confidence Report (CCR) - PWS ID # MS0240060
Attachments: NCBC 2018 CCR.pdf; RE: ALL HANDS - NCBC Gulfport - 2018 Water Quality Consumer Confidence R... (18.8 KB)
Signed By: kenton.lottinger@navy.mil

To: MSDH, Bureau of Public Water Supply,

Attached is copy of the Naval Construction Battalion Center Gulfport (PWS ID No. MS0240060 – 2018 Water Quality Consumer Confidence Report (CCR) issued yesterday 8 Apr 2019 and distributed to an estimated 7000 water consumers on-base as documented in attached email.

If any questions, please contact me.

Respectfully,

Kenton Lottinger
NAVFACSE PWD Gulfport (N45)
Environmental Division
Air/Water/EMS Program Manager
2401 Upper Nixon Ave.
Gulfport, MS 39501
COMM: 228-871-2373
FAX: 228-871-3116
Email: kenton.lottinger@navy.mil

From: Labadens, Ryan R CIV (USA) <ryan.labadens@navy.mil>
Sent: Monday, April 8, 2019 3:46 PM
Subject: ALL HANDS - NCBC Gulfport - 2018 Water Quality Consumer Confidence Report (CCR)

Please find attached the "NCBC Gulfport - 2018 Water Quality Consumer Confidence Report (CCR)" for Naval Construction Battalion Center Gulfport.

Ryan Labadens
Assistant Public Affairs Officer
Naval Construction Battalion Center Gulfport
4902 Marvin Shields Blvd.
Gulfport, MS 39501
Work: 228-871-2699
DSN: 312-868-2699

Email: ryan.labadens@navy.mil

Champion, Terleter

From: Lottinger, Kenton L CIV USN NAVFAC SE JAX FL (US) <kenton.lottinger@navy.mil>
Sent: Thursday, April 11, 2019 8:37 AM
To: reports, water
Cc: Noble, Lisa L CIV USN (US)
Subject: CORRECTION : NCBC Gulfport - PWD ID# MS0240060 - 2018 CCR Certification Form signed 9 Apr 2019
Attachments: NCBCGPT 2018 Water Quality CCR Certification Form signed 9 Apr 2019 - PWS ID # MS0240060.pdf; Revised NCBCGPT 2018 Water Quality CCR including Definitions and Terms.pdf; Email sent to Water Consumers on NCBCGPT - PWS ID# MS0240060 - Revised 2018 CCR with Definitions and Terms.pdf

To: MSDH, Bureau of Public Water Supply

In accordance with MSDH letter of 20 Mar 2019 providing 2018 analytical results, Naval Construction Battalion Center (NCBC) Gulfport, PWS ID #MS0240060, prepared and distributed a 2018 Water Quality Consumer Confidence Report (CCR) to water consumers on the base.

Attached is the NCBC Gulfport completed 2018 CCR Certification form signed 9 Apr 2019.

A copy of the revised CCR report has been posted for water consumer viewing and downloading at URL:
<https://www.dvidshub.net/publication/issues/46995> .

Realizing that social media is not allowed to satisfy "mail" and "Direct Delivery" requirement, as an extra measure, the base has posted the revised 2018 CCR on it's Facebook and Twitter sites.

The base has made a Good Faith effort to inform water consumers of the availability of the Revised 2018 Water Quality Consumer Confidence Report (CCR) and of who to contact should they have questions or require a hard copy of the report.

Should you have any questions in regards to the form and/or attachments, please contact me.

Respectfully,

Kenton Lottinger
NAVFACSE PWD Gulfport (N45)
Environmental Division
Air/Water/EMS Program Manager
2401 Upper Nixon Ave.
Gulfport, MS 39501

carolanne.b.hardy.mil@mail.mil; 'paul.b.groseclose.mil@mail.mil'
<paul.b.groseclose.mil@mail.mil>; Henson, Mark A CIV USN (US)
<mark.a.henson@navy.mil>; Webb, Brian K CIV USN (US)
<brian.k.webb@navy.mil>; Baldwin, Demetrius O CIV (USA)
<demetrius.baldwin@navy.mil>; Fountain, Lewis C CIV USN (USA)
<lewis.fountain@navy.mil>; Summers, Jacob T LT USN NAVFAC SE JAX FL (US)
<jacob.summers@navy.mil>; Bell, Mark W CIV USN (US) <mark.w.bell1@navy.mil>;
Flowers, Cynthia K CIV USN (USA) <cynthia.brooks@navy.mil>;
water.reports@msdh.ms.gov
Cc: Noble, Lisa L CIV USN (US) <lisa.noble@navy.mil>; Baker, S E CIV USN
NAVFAC ATLANTIC (US) <s.baker@navy.mil>; Mills, Mark A CIV NAVFAC SE, PWD
Gulfport <mark.a.mills1@navy.mil>
Subject: NCBC Gulfport's 2018 Water Quality Consumer Confidence Report
(CCR)"

To: All addressees

Attached is a copy of NCBC Gulfport 2018 Water Quality - Consumer Confidence Report (CCR).

Please insure the report is disseminated to all water users and consumers within your respective department or command by posting on command bulletin boards and/or by forwarding this email along with attachment on to them.

This report is required by USEPA and MSDH regulations to be disseminate to all water users and consumers on NCBC Gulfport as soon as possible but not later than 1 July 2019.

In addition, water users and consumers can obtain an electronic and/or hard copy of the report from the Public Works Department, Environmental Division office located in Building 322, Room 103 or by emailing a request to the PWD Environmental Div., Water Program Manager, at kenton.lottinger@navy.mil or by calling him at 228-871-2373.

Should you have any questions in regards to the report, please contact me.

Respectfully,

Kenton Lottinger
NCBC Gulfport
NAVFACSE PWD Gulfport
Environmental Division
Air, Water & EMS Program Manager
COMM: (228) 871-2373
DSN: 868-2373
Email: kenton.lottinger@navy.mil

FOR OFFICIAL USE ONLY - Privacy Act of 1974, as amended, applies. This email may contain information that must be protected in accordance with 5 U.S.C.s 552a, as implemented within the DoD by 32 C.F.R. Part 310 and DoD 5400.11R and with the Department of the Navy by SECNAVINST 5211.5D.

Lottinger, Kenton L CIV USN NAVFAC SE JAX FL (US)

From: Labadens, Ryan R CIV (USA) <ryan.labadens@navy.mil>
Sent: Tuesday, April 9, 2019 8:11 AM
To: Mills, Christina L CIV USN NAVFAC SE JAX FL (USA)
Cc: Lottinger, Kenton L CIV USN NAVFAC SE JAX FL (US); Lamar, Brian J NCBC Gulfport, NOO
Subject: RE: ALL HANDS - NCBC Gulfport - 2018 Water Quality Consumer Confidence Report (CCR)
Signed By: ryan.labadens@navy.mil

Hi Christina,

We have an email distribution list that we use for sending out ALL HANDS messages that contain the following group emails:

CNI_SE_GLFP_CBC_Global@navy.mil; SE_GLFP_ALL_HANDS@navy.mil; CENSECFOR_LS_Gulfport_All@navy.mil;
CNISE_GLFP_CBC_AllCDR'sMtgList@navy.mil; s71120c@navy.mil; USFF_GLFP_NCG_2_ALL_HANDS@navy.mil;
NMCB1_GLFP_ALFA2@navy.mil; NMCB1_GLFP_ALL@navy.mil; NMCB1_GLFP_BRAVO2@navy.mil;
NMCB1_GLFP_CHARLIE2@navy.mil; NMCB1_GLFP_DELTA2@navy.mil; NMCB1_GLFP_FIRSTCLASS@navy.mil;
NMCB1_GLFP_HQ2@navy.mil; NMCB1_GLFP_KHAKI2@navy.mil; NMCB1_GLFP_OFFICERS@navy.mil;
NMCB1_GLFP_PERMISSIONS@navy.mil; NMCB1_GLFP_SECOND_CLASS_PO@navy.mil;
NMCB11_GLFP_ALL_HANDS@navy.mil; NMCB133_GLFP_ALL_HANDS@navy.mil;
NMOPDC_GLFP_ALLHANDSLOCAL@navy.mil; NAVSUP_JAXS_FLGJ_GLFP@navy.mil; M-GLFP-NCTCAllServices@navy.mil

I don't know all the specific individuals that are included, so you may need to contact the actual groups those emails belong to in order to find out who is on them or exactly how many people they go to, but Brian estimated it is roughly 7,000 people.

Let me know if you need any more info.

Ryan

Ryan Labadens
Assistant Public Affairs Officer
Naval Construction Battalion Center Gulfport
4902 Marvin Shields Blvd.
Gulfport, MS 39501
Work: 228-871-2699
DSN: 312-868-2699
Email: ryan.labadens@navy.mil

From: Mills, Christina L CIV USN NAVFAC SE JAX FL (USA) <christina.mills@navy.mil>
Sent: Tuesday, April 9, 2019 7:42 AM
To: Labadens, Ryan R CIV (USA) <ryan.labadens@navy.mil>; Lamar, Brian J NCBC Gulfport, NOO <brian.lamar@navy.mil>
Cc: Lottinger, Kenton L CIV USN NAVFAC SE JAX FL (US) <kenton.lottinger@navy.mil>
Subject: FW: ALL HANDS - NCBC Gulfport - 2018 Water Quality Consumer Confidence Report (CCR)

Hi Brian and Ryan,

Kenton is tracking the dissemination of this report. In the email below, you sent it out to "All Hands". Who does that include?

Thanks for your help!

Very Respectfully,
Chris Mills

Office Administrator
Public Works Department
2401 Upper Nixon Ave, Bldg. 322
Gulfport, MS 39501-5001
(228) 871-2241
christina.mills@navy.mil

From: Lottinger, Kenton L CIV USN NAVFAC SE JAX FL (US) <kenton.lottinger@navy.mil>
Sent: Tuesday, April 9, 2019 6:46 AM
To: Mills, Christina L CIV USN NAVFAC SE JAX FL (USA) <christina.mills@navy.mil>
Subject: FW: ALL HANDS - NCBC Gulfport - 2018 Water Quality Consumer Confidence Report (CCR)

FYI

From: Labadens, Ryan R CIV (USA) <ryan.labadens@navy.mil>
Sent: Monday, April 8, 2019 3:46 PM
Subject: ALL HANDS - NCBC Gulfport - 2018 Water Quality Consumer Confidence Report (CCR)

Please find attached the "NCBC Gulfport - 2018 Water Quality Consumer Confidence Report (CCR)" for Naval Construction Battalion Center Gulfport.

Ryan Labadens
Assistant Public Affairs Officer
Naval Construction Battalion Center Gulfport
4902 Marvin Shields Blvd.
Gulfport, MS 39501
Work: 228-871-2699
DSN: 312-868-2699
Email: ryan.labadens@navy.mil

Lottinger, Kenton L CIV USN NAVFAC SE JAX FL (US)

From: Lottinger, Kenton CIV NAVFAC SE, PWD Gulfport
Sent: Tuesday, April 9, 2019 10:51 AM
To: Boogaart, Derek M LCDR USN (USA); Sims, Corinne A LT USN COMNAVEXPDCMBTCOM VA (USA); Reddinger, James T SCPO USN (USA); Akbar, Mohammed R LT USN (US); Vicchio, Nicolas (Nick) LT USN COMNAVEXPDCMBTCOM VA (USA); Reeder, Matthew S ENS USN (USA); Dillard, Christopher P PO1 USN NCHB THIRTEEN (USA); 'carl.lee@usmc.mil'; Hagen, Michael A CIV USN NFEXWC:PHE CA (USA); Reinike, Kim M CIV USN (USA); Bailey, William F CIV USN NAVCONSTRACEN GPT MS (USA); Halcin, Anthony D CIV USN (US); Duggins, Rodney E CIV USN (USA); Grindstaff, Kathy M CIV USN NAVSUPFLC JAX FL (US); Lee, William J CIV USN NAVSUPFLC JAX FL (US); Necaise, Dennis S CIV NAVSUP FLC Jacksonville, DLA-DDJG; 'Stamer, Wayne A Jr CIV USARMY 81 RSC (US)'; 'EDWARDS, CHRISTINA F'; SMITH, RUSSELL T (RUSSELL.T.SMITH@CBP.DHS.GOV); Calhan, Daniel P NAF USN COMNAVREG SE (USA); Lane, John M NAF USN (US); Bothe, Jason (Jason.Bothe@NEXWEB.ORG); Patterson, Curtis (Curtis.Patterson@nexweb.org); 'Anderson, Dana'; Taylor, Walter CIV CBC Gulfport; 'patricia.tice@deca.mil'; Grimbball, Raymond J CTR USN CENSECFOR VAB VA (USA); Flowers, Wayne A CTR (US); Maio, Bruno A CIV USN COMNAVREG SE (USA); 'genesia.n.salgado.mil@mail.mil'; 'carolanne.b.hardy.mil@mail.mil'; 'paul.b.groseclose.mil@mail.mil'; Henson, Mark A CIV USN (US); Webb, Brian K CIV USN (US); Baldwin, Demetrius O CIV (USA); Fountain, Lewis C CIV USN (USA); Summers, Jacob T LT USN NAVFAC SE JAX FL (US); Bell, Mark W CIV USN (US); Flowers, Cynthia K CIV USN (USA); water.reports@msdh.ms.gov
Cc: Noble, Lisa L CIV USN (US); Baker, S E CIV USN NAVFAC ATLANTIC (US); Mills, Mark A CIV NAVFAC SE, PWD Gulfport
Subject: NCBC Gulfport's 2018 Water Quality Consumer Confidence Report (CCR)"
Attachments: NCBCGPT 2018 Water Quality Consumer Confidence Report (CCR).pdf
Signed By: kenton.lottinger@navy.mil

To: All addressees

Attached is a copy of NCBC Gulfport 2018 Water Quality - Consumer Confidence Report (CCR).

Please insure the report is disseminated to all water users and consumers within your respective department or command by posting on command bulletin boards and/or by forwarding this email along with attachment on to them.

This report is required by USEPA and MSDH regulations to be disseminate to all water users and consumers on NCBC Gulfport as soon as possible but not later than 1 July 2019.

In addition, water users and consumers can obtain an electronic and/or hard copy of the report from the Public Works Department, Environmental Division office located in Building 322, Room 103 or by emailing a request to the PWD Environmental Div., Water Program Manager, at kenton.lottinger@navy.mil or by calling him at 228-871-2373.

Should you have any questions in regards to the report, please contact me.

Respectfully,

Kenton Lottinger
NCBC Gulfport
NAVFACSE PWD Gulfport
Environmental Division
Air, Water & EMS Program Manager
COMM: (228) 871-2373
DSN: 868-2373
Email: kenton.lottinger@navy.mil

FOR OFFICIAL USE ONLY - Privacy Act of 1974, as amended, applies. This email may contain information that must be protected in accordance with 5 U.S.C. § 552a, as implemented within the DoD by 32 C.F.R. Part 310 and DoD 5400.11R and with the Department of the Navy by SECNAVINST 5211.5D.